

Light Measurement Report

Print date: 8-5-2025

Measurement date and time: 8-5-2025 13:18:56 – Measurement no. VFR-250508-1157-MS

Measurement tracking No. and Link: [VT250508-008904](#)

Operator:



Laboratory and Equipment

Laboratory Owner and Location

Goniospectrometer System and Type

Sensor Name, Calibr. Date and Serial No.

Spectrometer Manufacturer and Model

Viso Systems, Copenhagen V, Denmark

LabSpion – Type C, horizontal

LabSensor Model2 – 11-1-2024 – 3130191315

Ibsen Photonics, Denmark – Freedom VIS (Custom Viso)

Measurement Conditions

Number of C-planes and Resolution

γ (gamma)-Resolution

Test Distance

Input Power, Power and Displ. Factors

Input RMS Voltage and Current

Frequency of Input Power

Warm-up Time and Variation

16 planes – 22,5°

5°

2,00 m

7,8 W – PF 0,92 – DPF 1,0

230 V – 0,037 A

50 Hz

Lamp stabilized in 15 min 2 sec – 2,0%

Tested Light Source

Product Name

Item No. and Manufacturer

Product Description (line 1)

800093-4000K

800093-4000K – Dutchfulfillment

3-FASE RAILSPOT | PANDO | 10W | ZWART

Main Light Measurement Results

Output – Total Lumen (Up% / Down%)

Efficiency

Peak Intensity and Beam Angle

Correlated Color Temperature, Target/Measured

Color Rendering Index

Color Rendering TM30-18

Color Shift, CIE duv and MacAdam Steps

Flicker

545 lm – 0,08% / 99,92%

70 lm/W

753 cd – 49,5°



CCT = 4000 K / 3919 K

CRI 82,2

R_f 83,5 – R_g 92,6

Duv 0,0052 – SDCM 5,0

SVM 0,01 – PstLM 0,02

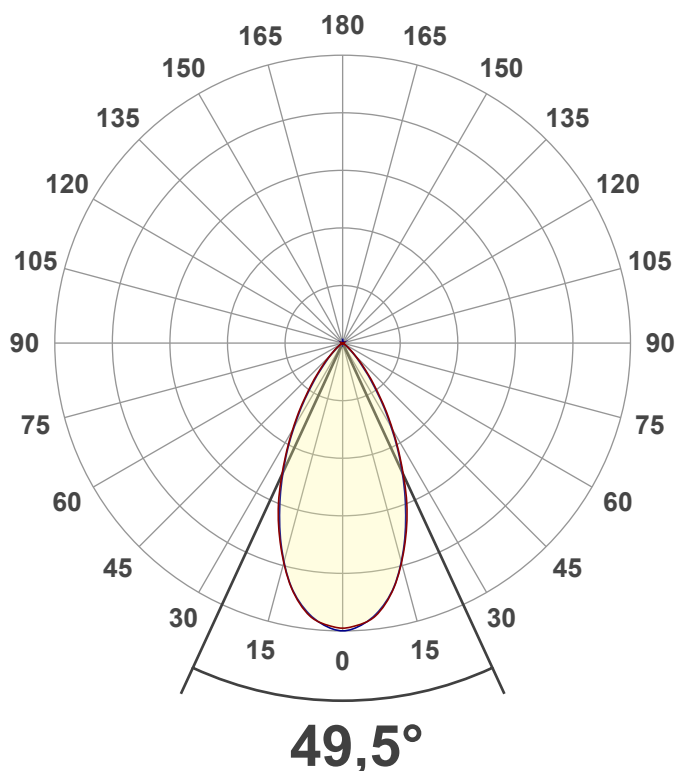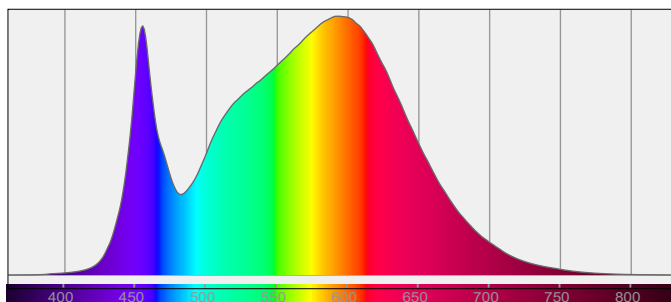

Light Measurement Report

Print date: 8-5-2025

Measurement date and time: 8-5-2025 13:18:56 – Measurement no. VFR-250508-1157-MS


Measurement tracking No. and Link: [VT250508-008904](#)

Operator:



Luminous Intensity diagram

Unit: 0-100% of peak intensity

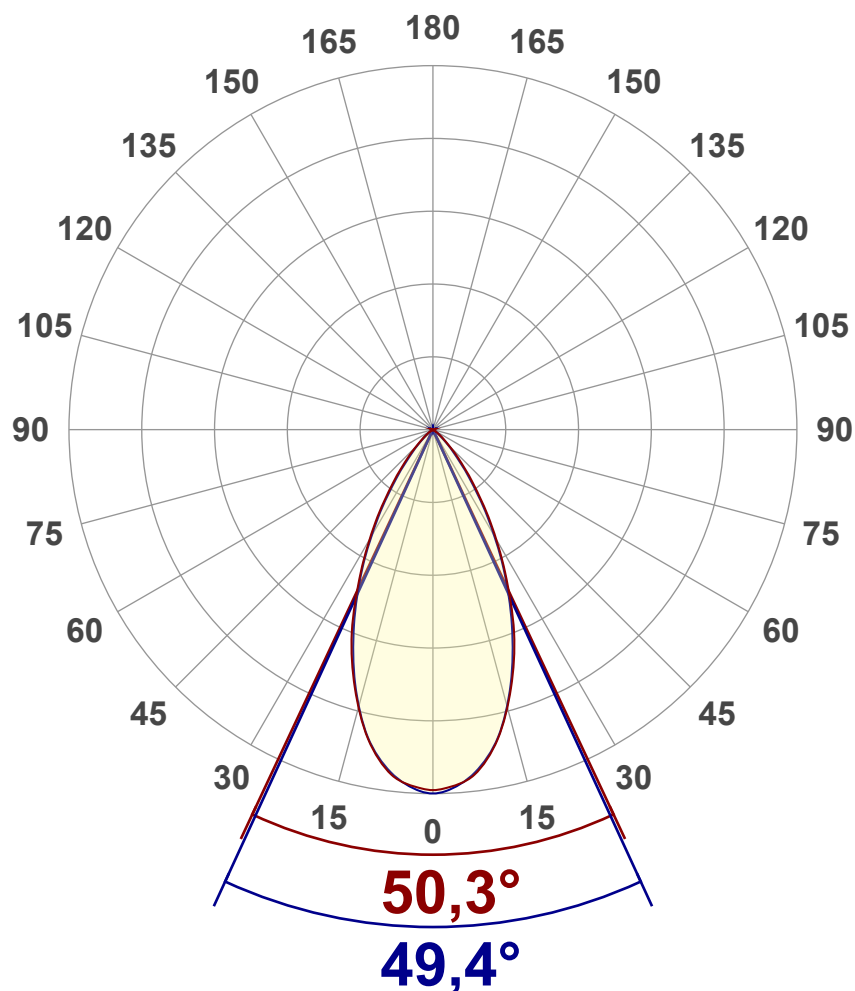

Main Values

Output (total Lumen)	545 lm
Lumen Up% / Down%	0,08% / 99,92%
Peak Intensity	753 cd
Beam Angle (50%)	49,5°
Beam Angle (90%)	49,4°
Beam Angle (10%)	50,3°

Cut-off Angle

Average 2,5%	101,2°
--------------	--------

Field Angle

Average 10%	82,8°
-------------	-------


Intensity Ratio

In 120° cone	99,6%
In 90° cone	96,0%

C000-C180

C090-C270

Linear distribution diagram - Intensity (candela) vs γ-angle

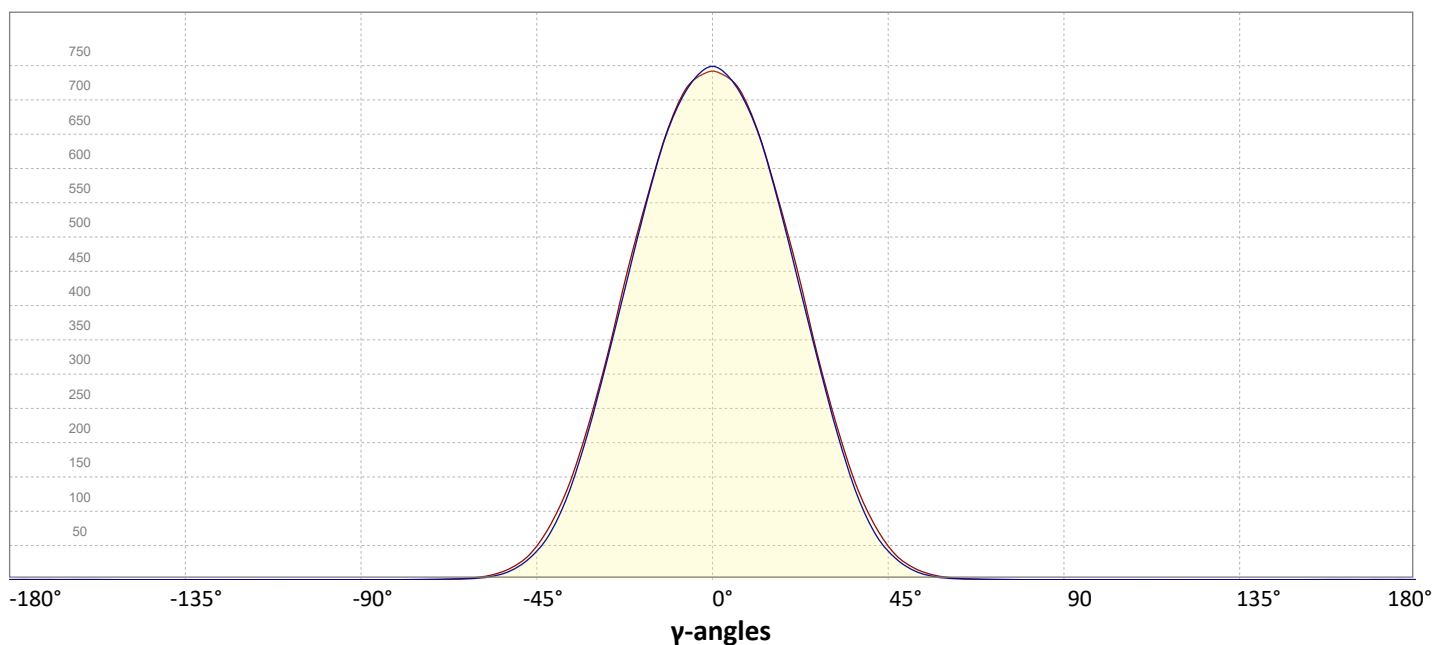


Light Measurement Report


Print date: 8-5-2025
Measurement date and time: 8-5-2025 13:18:56 – Measurement no. VFR-250508-1157-MS
Measurement tracking No. and Link: [VT250508-008904](#)
Operator:



Iso-intensity Diagram (Iso-candela)

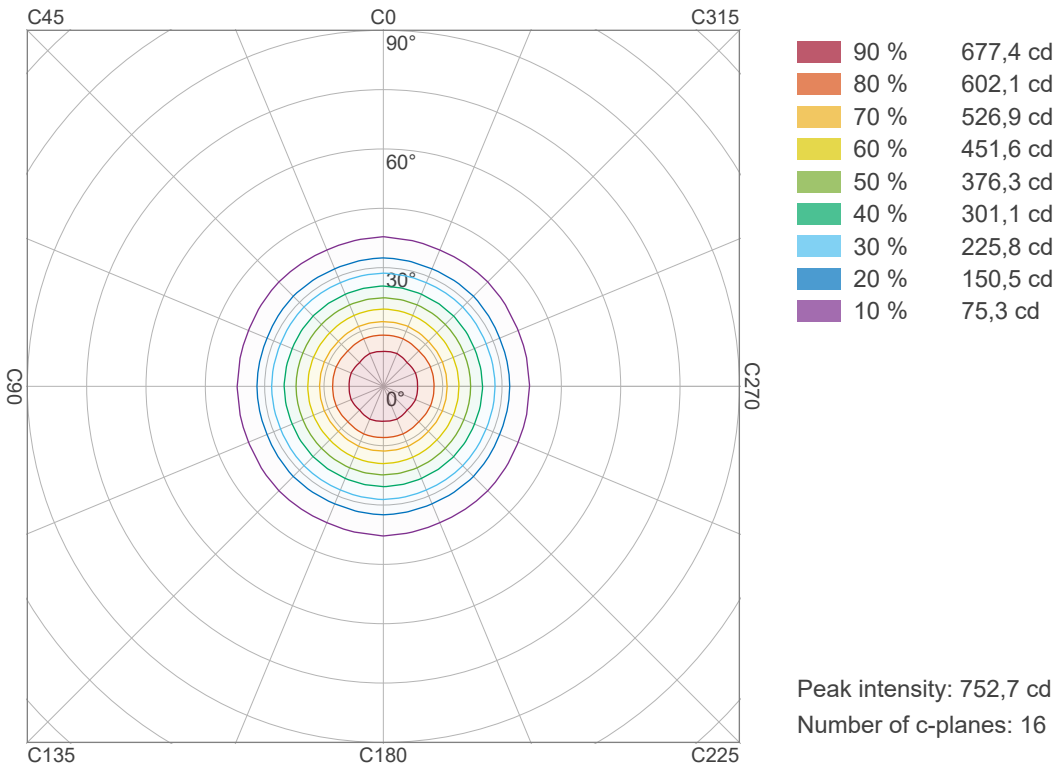

Iso-illuminance Diagram (Iso-lux)

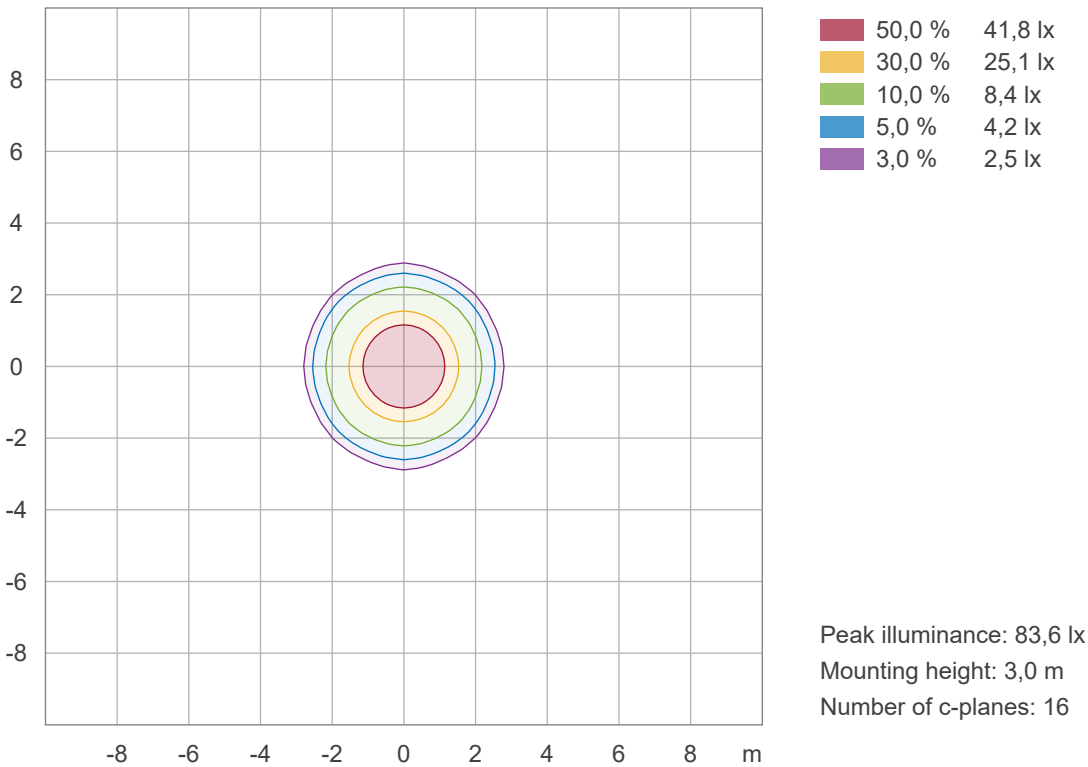

Light Measurement Report

Print date: 8-5-2025

Measurement date and time: 8-5-2025 13:18:56 – Measurement no. VFR-250508-1157-MS

Measurement tracking No. and Link: [VT250508-008904](#)

Operator:




Color details


Correlated Color Temperature, Target CCT = 4000 K
Correlated Color Temperature, Measured CCT = 3919 K
Color Rendering Index CRI 82,2
Color Rendering Index, R9 (red component) R9 = 2,9
Color Rendering TM30-18 R_f 83,5 – R_g 92,6
Color Quality Scale CQS = 82,4

MacAdam Steps
Color coordinates CIE 1931 (x;y) = (0,381;0,377)
Color coordinate CIEs 1960 (u;v) = (0,225;0,334)
Color deviation from BBL Duv = 0,0052
Color coordinate CIEs 1976 (CIELUV) (u';v') = (0,225;0,502)


CIE 1931

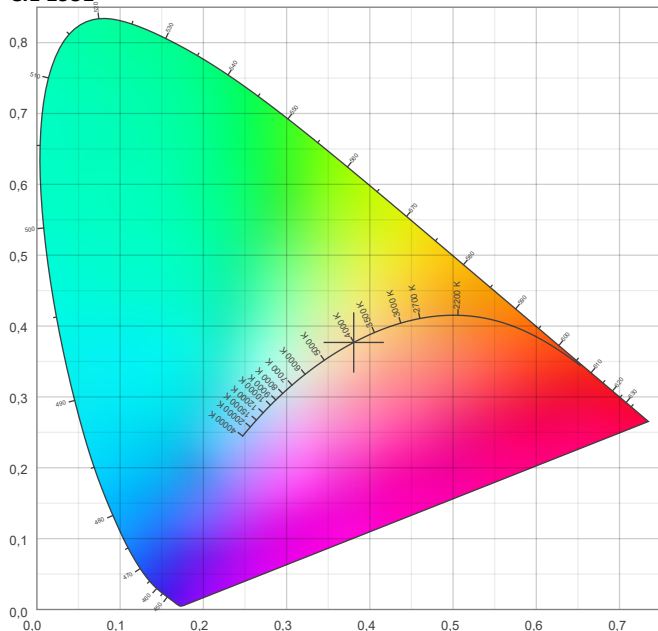

CIE 1931 – zoomed on Planckian locus

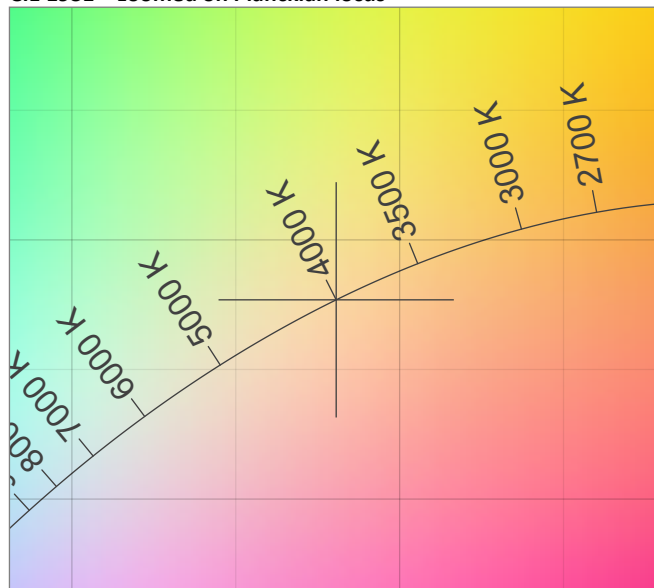


Color Rendering Index per reference color (CIE 1995)

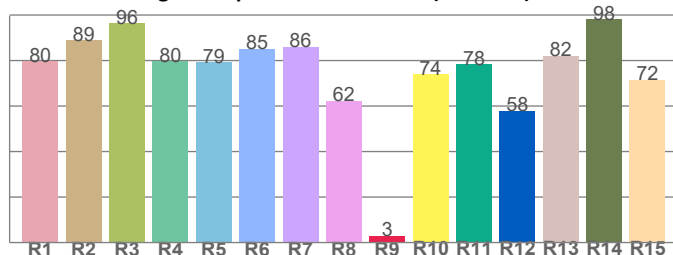


CRI R values, only R1-R8 are used to calculate final CRI value

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
79,7	89,0	96,3	79,7	79,2	85,1	86,0	62,3	2,9	74,0	78,3	57,9	82,1	98,1	71,6

Spectral power distribution (SPD) / W/nm – 0-100%

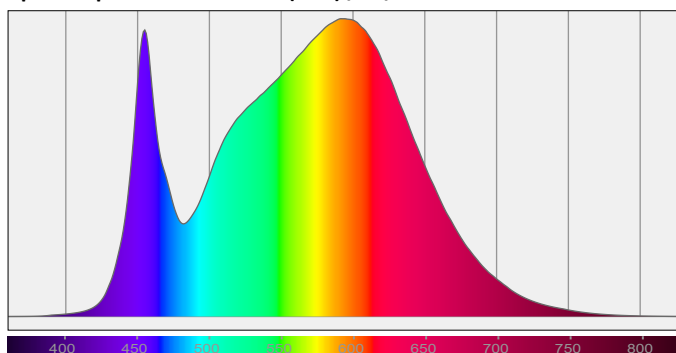


TM30-18 R_f-values per hue bin

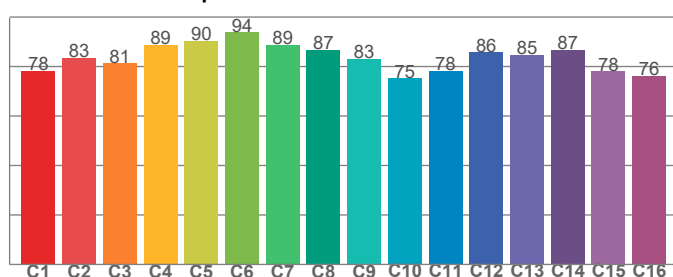

TM30 C values, 16 binned values out of total of 99 C values

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
78,3	83,5	81,2	88,8	90,5	93,8	88,8	86,8	83,2	75,3	78,3	85,7	84,7	86,8	78,2	76,3

Color Quality Scale by reference color

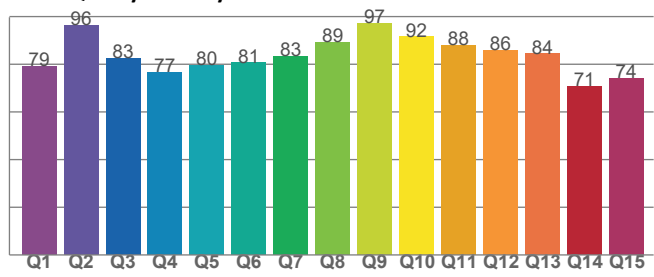

CQS Q values

Q1	Q2	Q3	Q4	Q5	Q6	Q7	Q8	Q9	Q10	Q11	Q12	Q13	Q14	Q15
79,1	96,4	82,5	76,8	79,7	80,7	83,4	89,2	97,2	91,6	88,0	86,0	84,4	70,7	74,3

Light Measurement Report

Print date: 8-5-2025


Measurement date and time: 8-5-2025 13:18:56 – Measurement no. VFR-250508-1157-MS

Measurement tracking No. and Link: [VT250508-008904](#)

Operator:



Beam Details

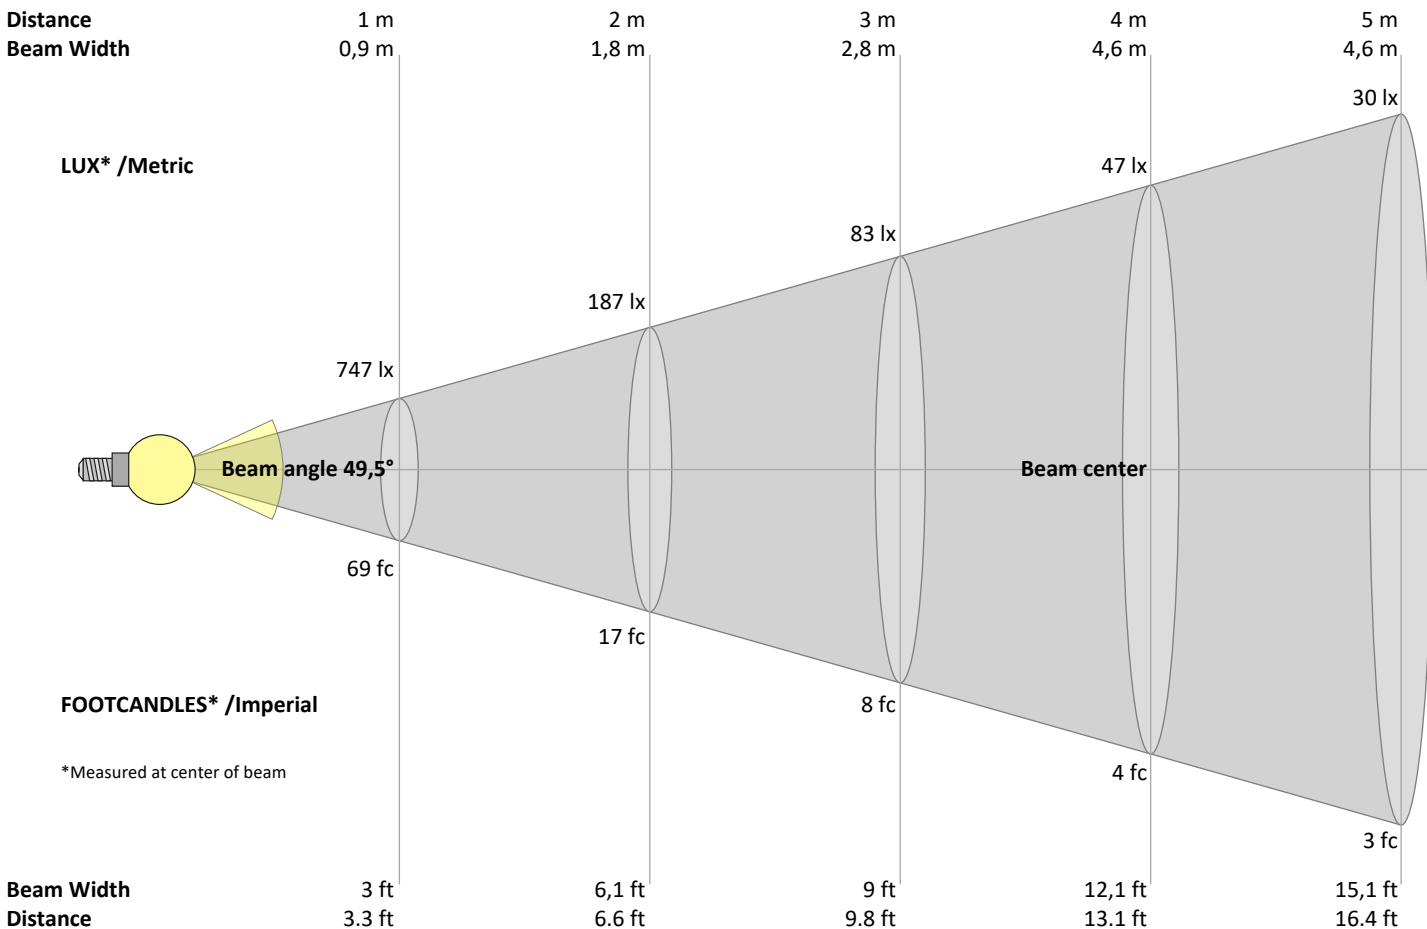

Beam intensities from 1 – 20 m

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	m
3,3	6,6	9,8	13,1	16,4	19,7	23	26,2	29,5	32,8	36,1	39,4	42,7	45,9	49,2	52,5	55,8	59,1	62,3	65,6	ft
747	187	83	47	30	21	15	12	9	7	6	5	4	4	3	3	3	2	2	2	lux
69,4	17,3	7,7	4,3	2,8	1,9	1,4	1,1	0,9	0,7	0,6	0,5	0,4	0,4	0,3	0,3	0,2	0,2	0,2	0,2	fc

Intensities in 0° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
747	738	729	720	701	675	648	609	571	530	488	445	397	349	305	263	221	187	152	123	cd
100%	99%	98%	96%	94%	90%	87%	82%	76%	71%	65%	60%	53%	47%	41%	35%	30%	25%	20%	16%	of 0°val

Intensities in 90° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
747	745	731	718	698	672	647	607	567	525	479	434	388	343	298	255	213	177	142	112	cd
100%	100%	98%	96%	94%	90%	87%	81%	76%	70%	64%	58%	52%	46%	40%	34%	28%	24%	19%	15%	of 0° val

Intensities in 180° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
747	738	729	720	701	675	648	609	571	530	488	445	397	349	305	263	221	187	152	123	cd
100%	99%	98%	96%	94%	90%	87%	82%	76%	71%	65%	60%	53%	47%	41%	35%	30%	25%	20%	16%	of 0 val

Intensities in 270° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
747	745	731	718	698	672	647	607	567	525	479	434	388	343	298	255	213	177	142	112	cd
100%	100%	98%	96%	94%	90%	87%	81%	76%	70%	64%	58%	52%	46%	40%	34%	28%	24%	19%	15%	of 0°val

Light Measurement Report

Print date: 8-5-2025

Measurement date and time: 8-5-2025 13:18:56 – Measurement no. VFR-250508-1157-MS

Measurement tracking No. and Link: [VT250508-008904](#)

Operator:



Light Planning – UGR table

Uncorrected, comprehensive UGR table according to 117-1995

Reflectances											
ρ Ceiling		70	70	50	50	30	70	70	50	50	30
ρ Walls		50	30	50	30	30	50	30	50	30	30
ρ Floor		20	20	20	20	20	20	20	20	20	20
Room size		Viewed Crosswise					Viewed Endwise				
H = mounting height above eye level		(Viewing direction orthogonal to lamp length axis)					(Viewing direction parallel to lamp length axis)				
X	Y										
2H	2H	20,9	21,6	21,1	21,8	22,0	20,6	21,2	20,7	21,4	21,6
	3H	20,7	21,4	21,0	21,6	21,8	20,3	21,0	20,6	21,2	21,4
	4H	20,6	21,3	21,0	21,5	21,8	20,2	20,9	20,6	21,2	21,4
	6H	20,6	21,2	20,9	21,5	21,8	20,2	20,8	20,5	21,1	21,4
	8H	20,5	21,1	20,8	21,4	21,8	20,1	20,7	20,5	21,1	21,4
	12H	20,5	21,0	20,8	21,4	21,8	20,1	20,7	20,4	21,0	21,4
4H	2H	20,6	21,3	21,0	21,6	21,8	20,2	20,9	20,6	21,2	21,4
	3H	20,5	21,1	20,8	21,4	21,8	20,1	20,7	20,5	21,0	21,5
	4H	20,3	20,9	20,8	21,3	21,8	20,0	20,5	20,4	20,9	21,4
	6H	20,3	20,8	20,8	21,2	21,5	19,9	20,4	20,4	20,8	21,1
	8H	20,2	20,7	20,7	21,1	21,4	19,8	20,3	20,3	20,7	21,0
	12H	20,1	20,5	20,7	21,0	21,4	19,8	20,2	20,3	20,6	21,0
8H	4H	20,2	20,7	20,7	21,1	21,4	19,8	20,3	20,3	20,7	21,0
	6H	20,1	20,5	20,7	20,9	21,5	19,8	20,1	20,3	20,6	21,1
	8H	20,1	20,4	20,7	20,9	21,6	19,8	20,0	20,3	20,5	21,2
	12H	20,1	20,3	20,7	20,8	21,4	19,7	19,9	20,3	20,4	21,0
12H	4H	20,1	20,5	20,7	21,0	21,4	19,8	20,2	20,3	20,6	21,0
	6H	20,1	20,4	20,7	20,9	21,6	19,8	20,0	20,3	20,5	21,2
	8H	20,1	20,3	20,7	20,8	21,4	19,7	19,9	20,3	20,4	21,0
Variations with the observer position for the luminaire spacings, S:											
S = 1.0H		4,2 / -9,6					4,4 / -10,6				
S = 1.5H		6,8 / -15,5					6,9 / -16,6				
S = 2.0H		8,7 / -18,8					8,8 / -19,0				

Coefficients of Utilization

Ceiling reflectance	80			70			50			30			10			0		
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR		(RCR: Room Cavity Ratio)			Room Values are expressed as percentage of Lumen delivered to the task surface													
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	108	106	111	109	107	105	105	103	101	101	100	98	98	96	95	94
2	108	103	99	96	106	102	98	95	98	96	93	95	93	91	93	91	89	87
3	103	97	92	88	101	95	91	87	93	89	86	90	87	84	88	85	83	82
4	98	91	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76
5	93	85	79	75	91	84	79	75	82	78	74	81	77	73	79	76	73	71
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67
7	84	75	70	65	83	75	69	65	73	68	65	72	68	65	71	67	64	63
8	80	71	65	61	79	71	65	61	70	65	61	69	64	61	68	64	60	59
9	77	67	62	58	76	67	61	58	66	61	58	65	61	57	64	60	57	56
10	73	64	58	55	72	64	58	55	63	58	54	62	57	54	61	57	54	53

Light Measurement Report


Print date: 8-5-2025
Measurement date and time: 8-5-2025 13:18:56 – Measurement no. VFR-250508-1157-MS
Measurement tracking No. and Link: [VT250508-008904](#)
Operator:



Luminaire budgetary diagram

Uncorrected, comprehensive UGR table according to 117-1995

LAMPS (number of lamps)

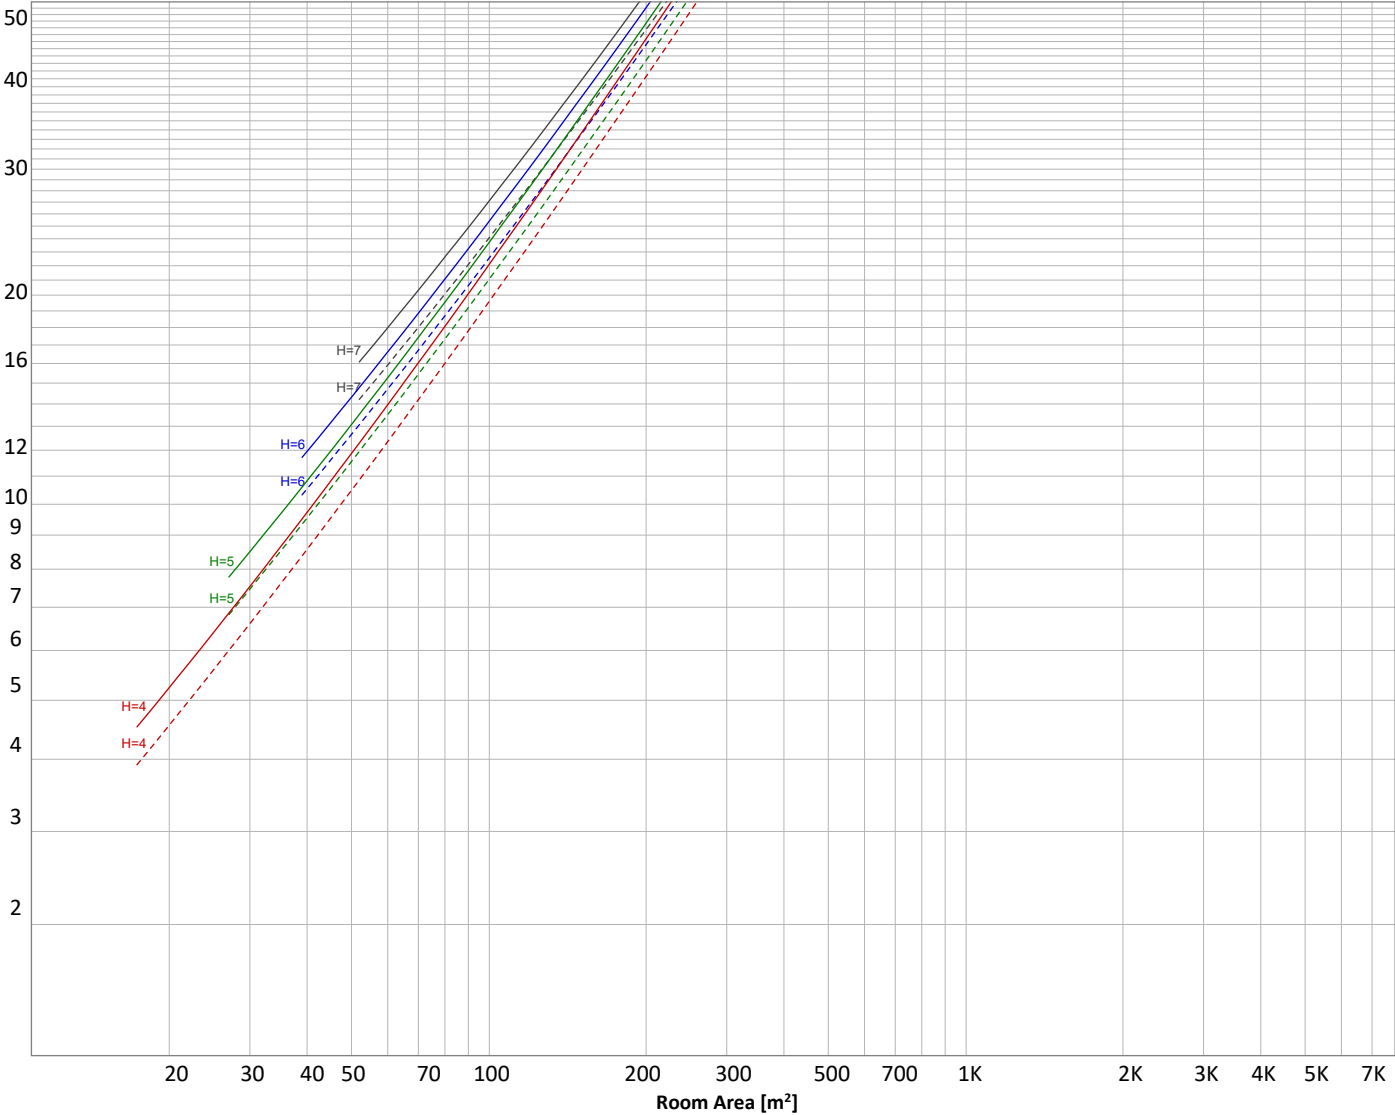

Conditions

H = Room height	Flux = 545 lm	p(%)		
H _{down} = Lamp distance from ceiling =	0.00 m	Line type	Ceiling reflectance	Wall reflectance
H _{work} = Work area height from floor =	0.00 m	-----	70	50
E _{work} = Average lux on work area =	100 lx	_____	50	30
				Floor reflectance
				20

Zonal Lumen Summary

0°-10°	10°-20°	20°-30°	30°-40°	40°-50°	50°-60°	60°-70°	70°-80°	80°-90°
68,5 lm	164 lm	168 lm	100 lm	35,2 lm	7,54 lm	1,32 lm	0,343 lm	0,045 lm
90°-100°	100°-110°	110°-120°	120°-130°	130°-140°	140°-150°	150°-160°	160°-170°	170°-180°
0,036 lm	0,034 lm	0,033 lm	0,033 lm	0,050 lm	0,076 lm	0,097 lm	0,068 lm	0,025 lm

Light Measurement Report

Print date: 8-5-2025

Measurement date and time: 8-5-2025 13:18:56 – Measurement no. VFR-250508-1157-MS

Measurement tracking No. and Link: [VT250508-008904](#)

Operator:



Outdoor Light Planning

Lumen per Zone

Zone (γ)	Lumen	% Total
0-10°	68 lm	12,6%
10-20°	164 lm	30,1%
20-30°	168 lm	30,7%
30-40°	100 lm	18,4%
40-50°	35 lm	6,4%
50-60°	8 lm	1,4%
60-70°	1 lm	0,2%
70-80°	0 lm	0,1%
80-90°	0 lm	0,0%
90-100°	0 lm	0,0%
100-110°	0 lm	0,0%
110-120°	0 lm	0,0%
120-130°	0 lm	0,0%
130-140°	0 lm	0,0%
140-150°	0 lm	0,0%
150-160°	0 lm	0,0%
160-170°	0 lm	0,0%
170-180°	0 lm	0,0%
Total	545 lm	100,0%

Intensity peaks

Max intensity	753 cd
Intensity, 90°	0 cd
Intensity, 0°	747 cd

Zonal Lumen summary

Zone (γ)	Lumen	% Total
0-30°	400 lm	73,4%
0-40°	501 lm	91,8%
0-60°	543 lm	99,6%
60-90°	2 lm	0,3%
70-100°	0 lm	0,1%
90-120°	0 lm	0,0%
0-90°	545 lm	99,9%
90-180°	0 lm	0,1%
0-180°	545 lm	100,0%

BUG rating

	Lumen	% Total
Forward light		
Low(0-30°)	199 lm	36,4%
Medium(30-60°)	73 lm	13,4%
High(60-80°)	1 lm	0,2%
Very high(80-90°)	0 lm	0,0%
Back light		
Low(0-30°)	199 lm	36,4%
Medium(30-60°)	73 lm	13,4%
High(60-80°)	1 lm	0,2%
Very high(80-90°)	0 lm	0,0%


Uplight

Low(90-100°)	0 lm	0,0%
High(100-180°)	0 lm	0,1%

IESNA TM-15-07

Luminaire Classification System For Outdoor Luminaires

BUG rating B1 U0 G0

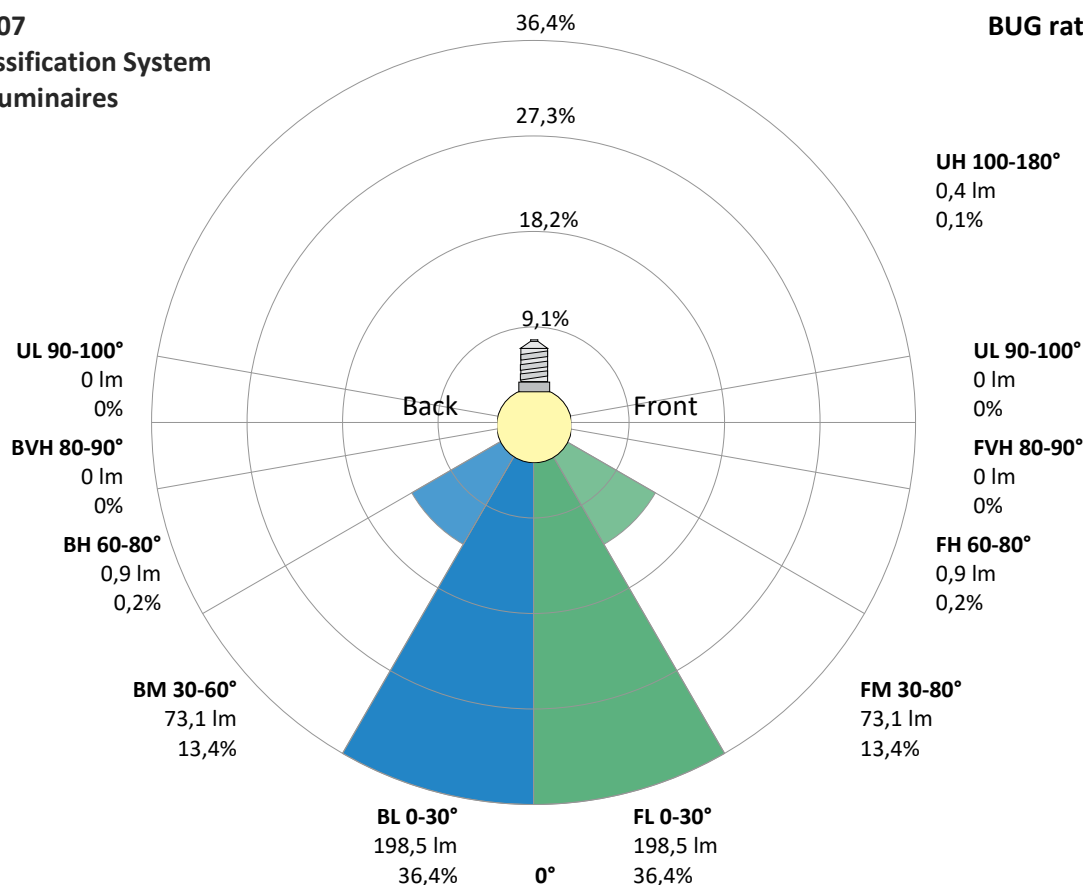

Light Measurement Report

Print date: 8-5-2025
Measurement date and time: 8-5-2025 13:18:56 – Measurement no. VFR-250508-1157-MS
Measurement tracking No. and Link: [VT250508-008904](#)
Operator:




Power Details


Input Power

Power feed to light source	7,8 W
Frequency of input power	50 Hz
RMS Input voltage feed, V_{RMS}	230 V
RMS Input current feed, I_{RMS}	0,037 A
Volt-Ampere or apparent power = $V_{RMS} * I_{RMS}$	8,47 VA
Displacement factor of AC power feed	1,0
Power factor of AC current feed	0,92
Total harmonic distortion of the current	39,54%
Total harmonic distortion of the voltage	0,07%

Input Power Curve

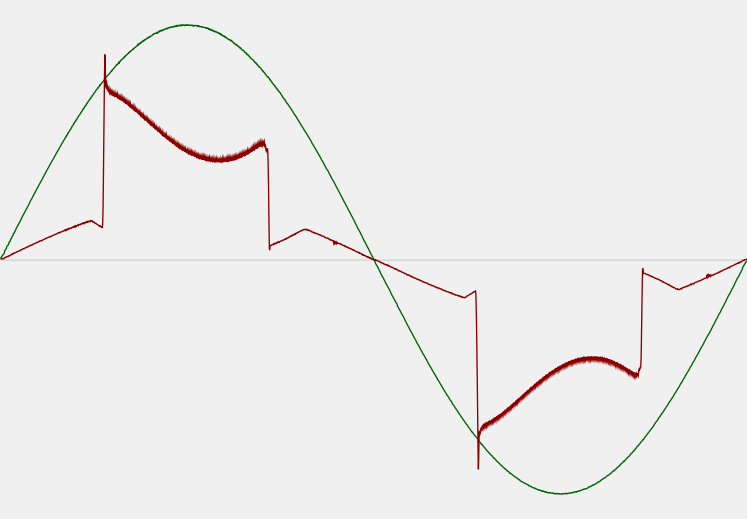

Efficiency

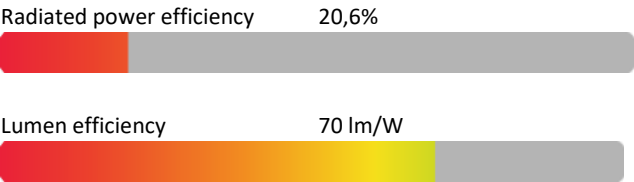

Stabilization Details

Warmup Conditions

Stable period	15 min
Stable change max	2,0%
Minimum time	15 min

Color Temperature Change

CCT start	3999 K
CCT shift	+1 K
CCT end	4000 K


Warmup Result

Total warmup time	Lamp stabilized in 15 min 2 sec
Warmup variation	+0,2%

Output Change

Output start	545 lm
Output change	+ 1m
Output end	545 lm

Stabilization Curve

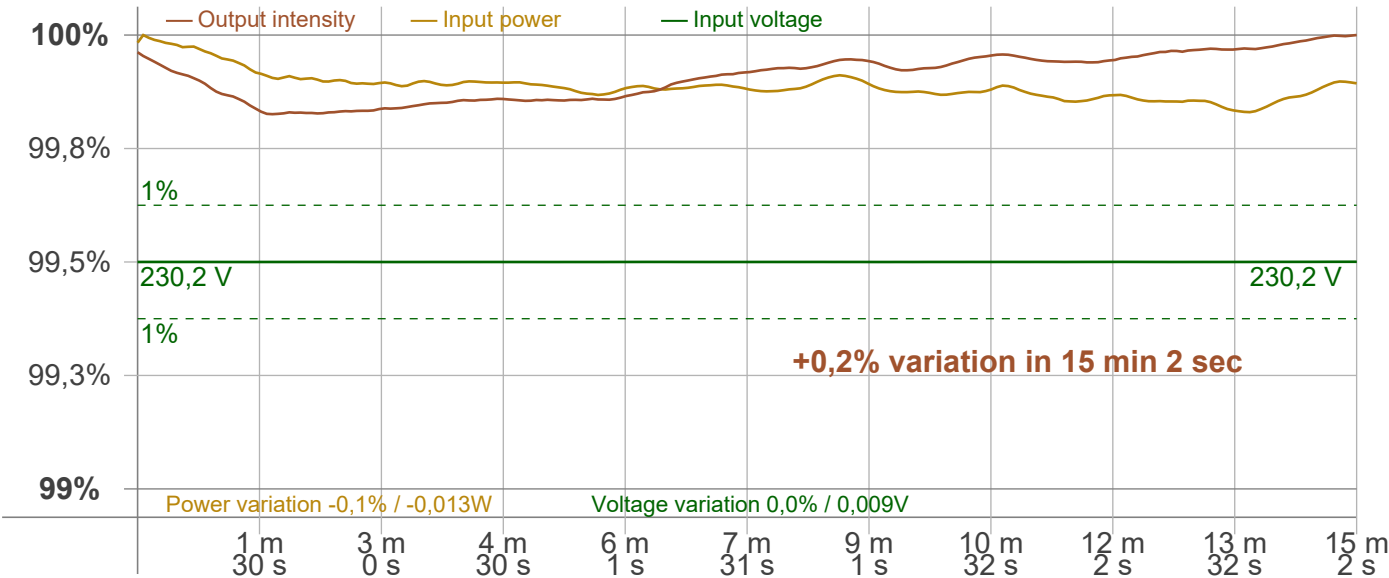

Light Measurement Report


Print date: 8-5-2025
Measurement date and time: 8-5-2025 13:18:56 – Measurement no. VFR-250508-1157-MS
Measurement tracking No. and Link: [VT250508-008904](#)
Operator:



Flicker /TLA details

Flicker Meter Type	Viso Systems LabFlicker	Measurement time	
Frequency of input power	50 Hz	PstLM	180 sec
Flicker/TLA sample rate	20000 samples/s	All other indices	1,2 sec
Flicker indices according to Illuminating Engineering Society (IES)		Flicker indices according to California Energy Commission (CEC) 2016b	
Flicker frequency	100 Hz	JA8/10 40 Hz	0,01 %
Percent Flicker	0,39 %	JA8/10 90 Hz	0,03 %
Flicker index	0	JA8/10 200 Hz	0,33 %
TLA indices (re IEC TR 61547-1, IEC 61000-3-3 and IEC 61000-4-15)		JA8/10 400 Hz	0,37 %
PstLM value (F < 80 Hz)	0,02	JA8/10 1000 Hz	0,39 %
SVM value (80 < F < 2000 Hz)	0,01	Flicker indices according to Lighting Research Center (2015)	
		Perception metric, Assist Mp	0

Flicker frame (frame of one flicker period in time domain)

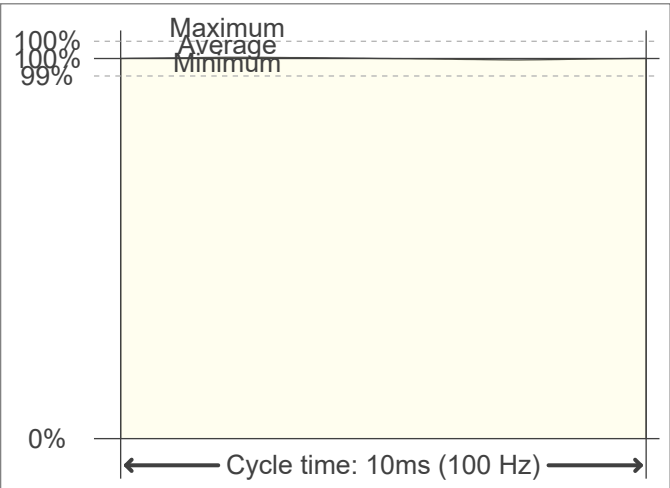

Flicker FFT (flicker curve in frequency domain)



IEEE 1789 Frequency/modulation plot

