

Light Measurement Report

Print date: 7-11-2025

Measurement date and time: 7-11-2025 10:04:05 – Measurement no. VFR-251107-3985-MS

Measurement tracking No. and Link: [VT251107-004753](#)

Operator:



Laboratory and Equipment

Laboratory Owner and Location

Goniospectrometer System and Type

Sensor Name, Calibr. Date and Serial No.

Spectrometer Manufacturer and Model

Viso Systems, Copenhagen V, Denmark

LabSpion – Type C, horizontal

LabSensor Model2 – 11-1-2024 – 3130191315

Ibsen Photonics, Denmark – Freedom VIS (Custom Viso)

Measurement Conditions

Number of C-planes and Resolution

γ (gamma)-Resolution

Test Distance

Input Power, Power and Displ. Factors

Input RMS Voltage and Current

Frequency of Input Power

Warm-up Time and Variation

72 planes – 5°

5°

2,00 m

5,4 W – PF 0,44 – DPF 0,98

230 V – 0,053 A

50 Hz

Lamp stabilized in 15 min 2 sec – 2,0%

Tested Light Source

Product Name

Item No. and Manufacturer

Product Description (line 1)

FUTC04-6500K

FUTC04-6500K – Dutchfulfillment

MI-LIGHT GARDEN LIGHT 6W RGB+CCT

Main Light Measurement Results

Output – Total Lumen (Up% / Down%)

Efficiency

Peak Intensity and Beam Angle

Correlated Color Temperature, Target/Measured

Color Rendering Index

Color Rendering TM30-18

Color Shift, CIE duv and MacAdam Steps

Flicker

501 lm – 0,03% / 99,97%

93 lm/W

1710 cd – 27,3°



CCT = 6500 K / 6327 K

CRI 82,7

R_f 81,7 – R_g 92,4

Duv 0,0044 – SDCM 6,0

SVM n/a – PstLM n/a

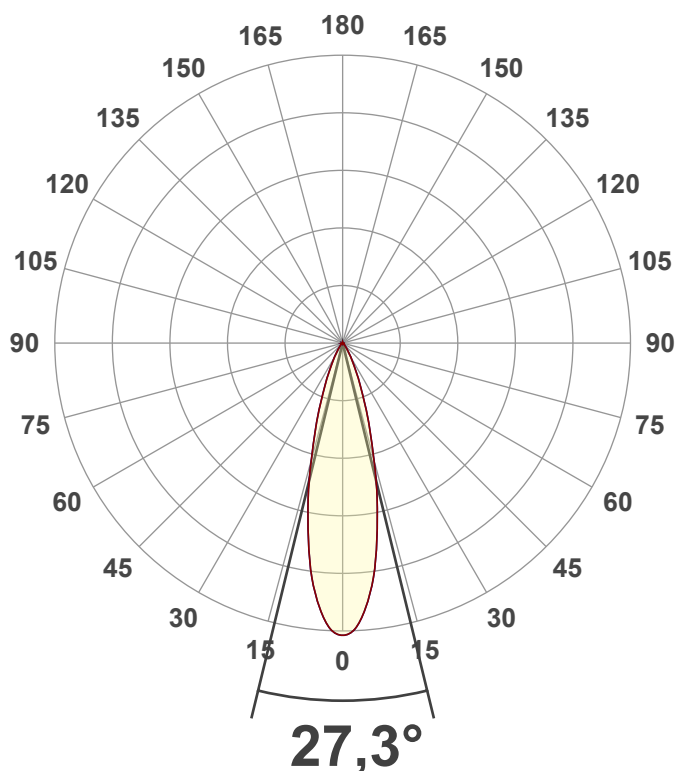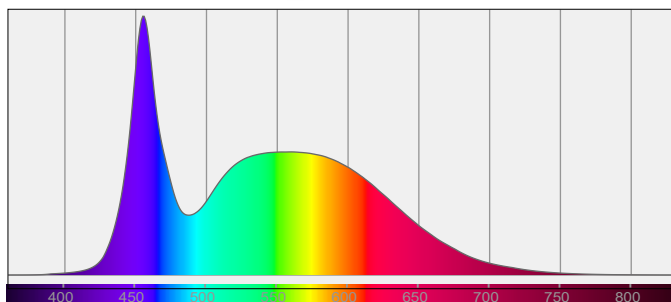

Light Measurement Report

Print date: 7-11-2025

Measurement date and time: 7-11-2025 10:04:05 – Measurement no. VFR-251107-3985-MS


Measurement tracking No. and Link: [VT251107-004753](#)

Operator:



Luminous Intensity diagram

Unit: 0-100% of peak intensity

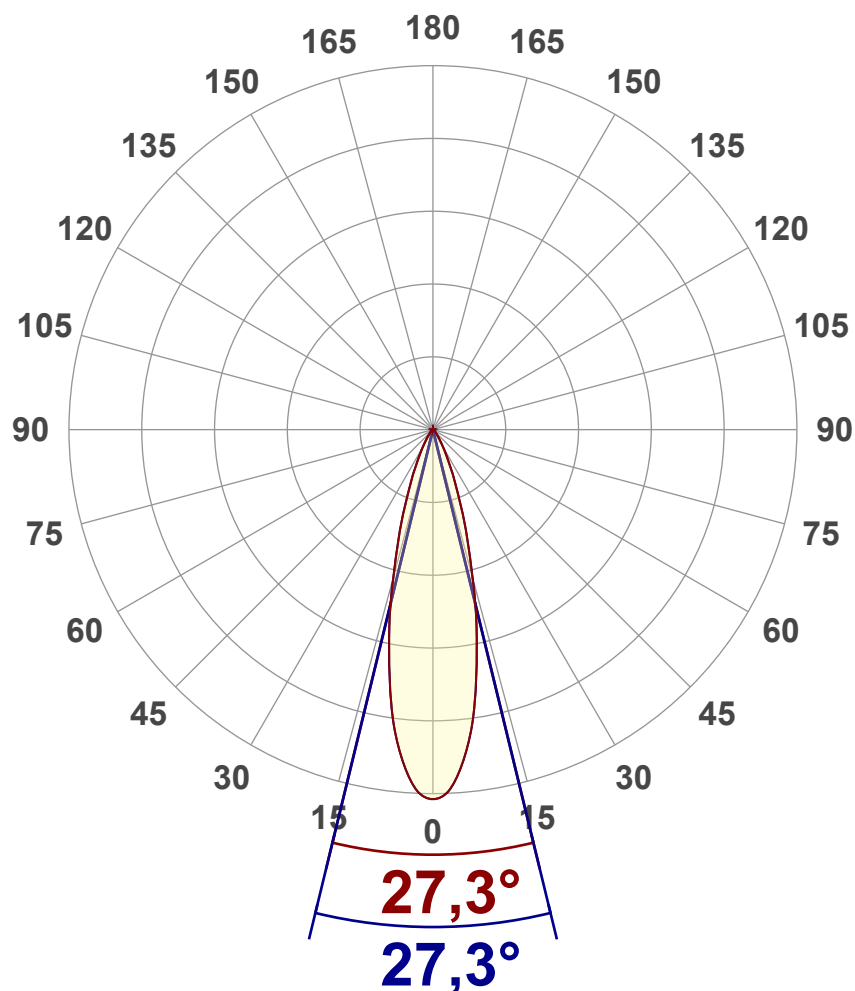

Main Values

Output (total Lumen)	501 lm
Lumen Up% / Down%	0,03% / 99,97%
Peak Intensity	1710 cd
Beam Angle (50%)	27,3°
Beam Angle (90%)	27,3°
Beam Angle (10%)	27,3°

Cut-off Angle

Average 2,5%	72,6°
--------------	-------

Field Angle

Average 10%	52,5°
-------------	-------


Intensity Ratio

In 120° cone	97,8%
In 90° cone	94,7%

C000-C180

C090-C270

Linear distribution diagram - Intensity (candela) vs γ-angle

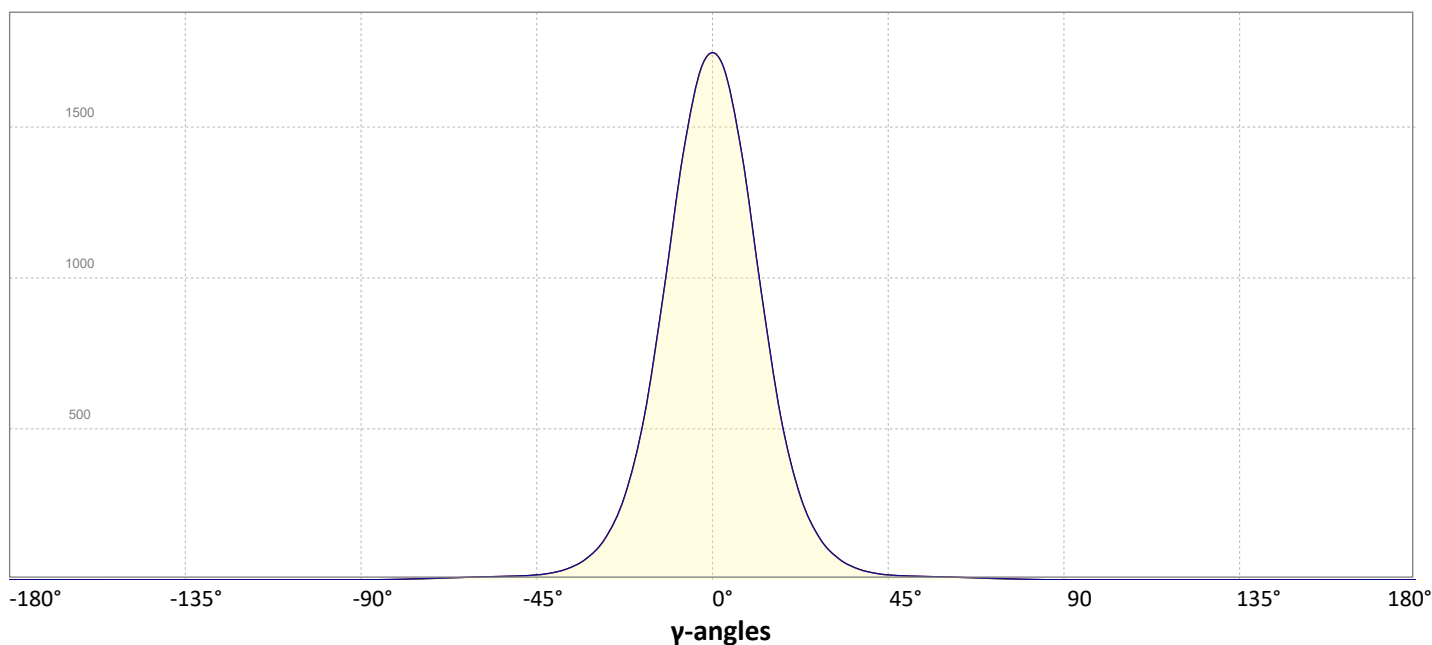


Light Measurement Report


Print date: 7-11-2025
Measurement date and time: 7-11-2025 10:04:05 – Measurement no. VFR-251107-3985-MS
Measurement tracking No. and Link: [VT251107-004753](#)
Operator:



Iso-intensity Diagram (Iso-candela)

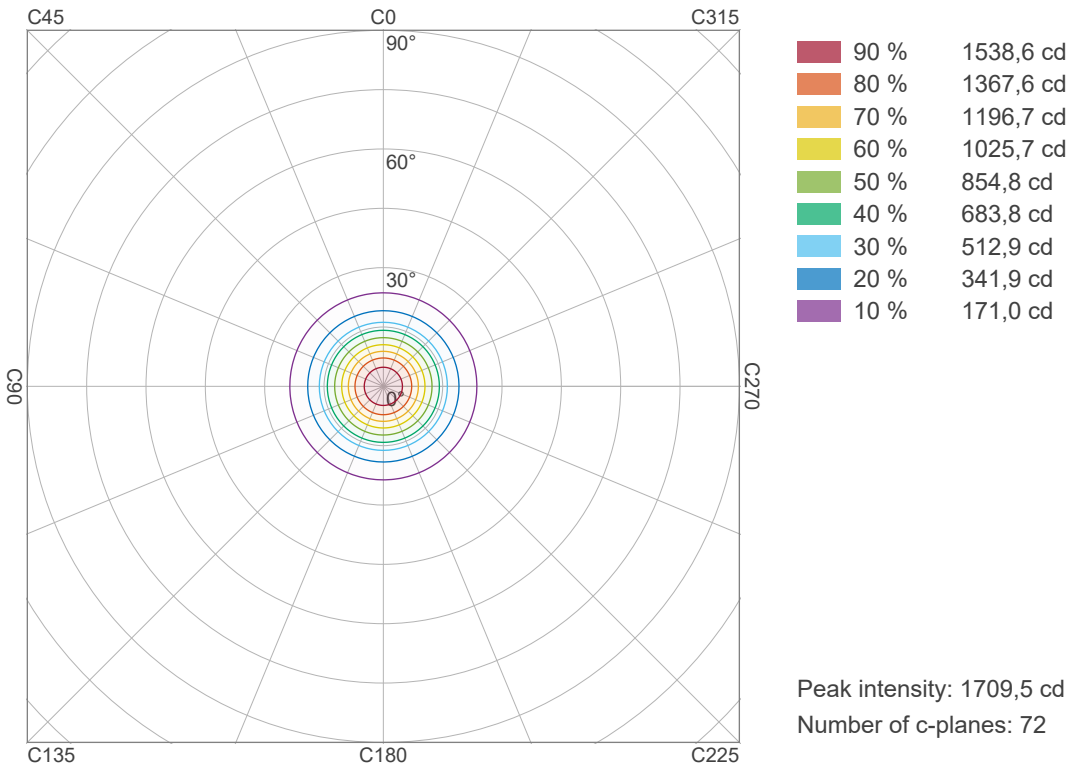

Iso-illuminance Diagram (Iso-lux)

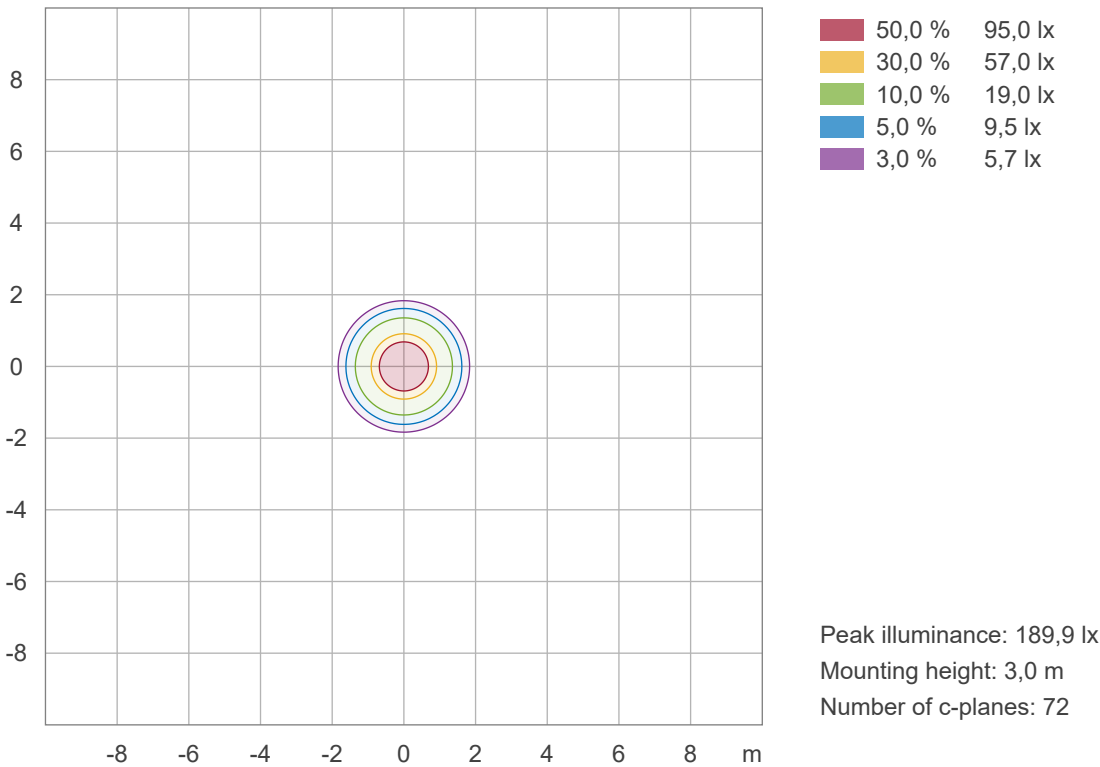

Light Measurement Report

Print date: 7-11-2025

Measurement date and time: 7-11-2025 10:04:05 – Measurement no. VFR-251107-3985-MS

Measurement tracking No. and Link: [VT251107-004753](https://vfr-251107-004753)

Operator:




Color details


Correlated Color Temperature, Target CCT = 6500 K
Correlated Color Temperature, Measured CCT = 6327 K
Color Rendering Index CRI 82,7
Color Rendering Index, R9 (red component) R9 = 8,7
Color Rendering TM30-18 R_f 81,7 – R_g 92,4
Color Quality Scale CQS = 79,5

MacAdam Steps
Color coordinates CIE 1931 (x;y) = (0,314;0,324)
Color coordinate CIEs 1960 (u;v) = (0,200;0,310)
Color deviation from BBL Duv = 0,0044
Color coordinate CIEs 1976 (CIELUV) (u';v') = (0,200;0,466)


CIE 1931

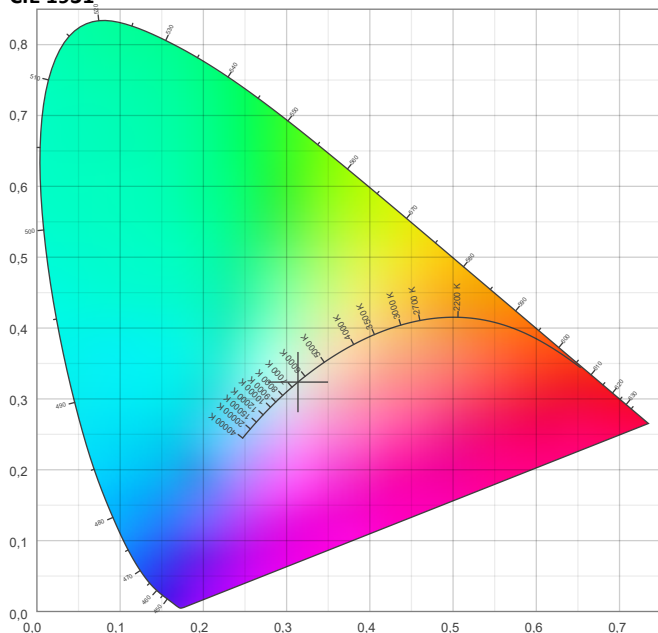

CIE 1931 – zoomed on Planckian locus

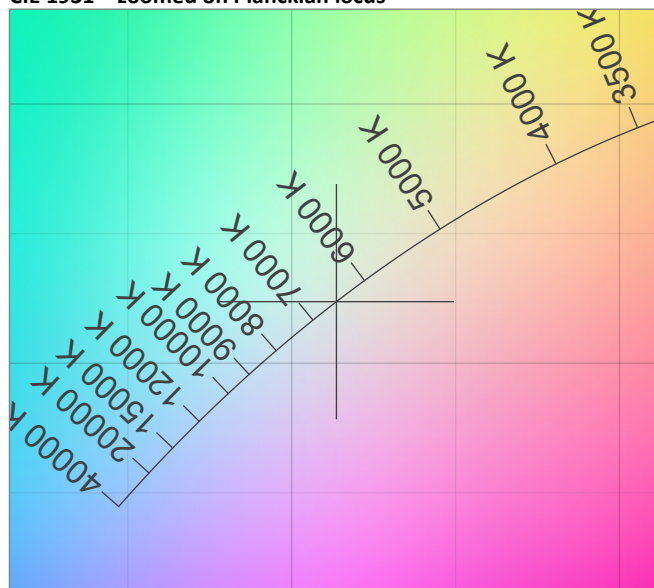


Color Rendering Index per reference color (CIE 1995)

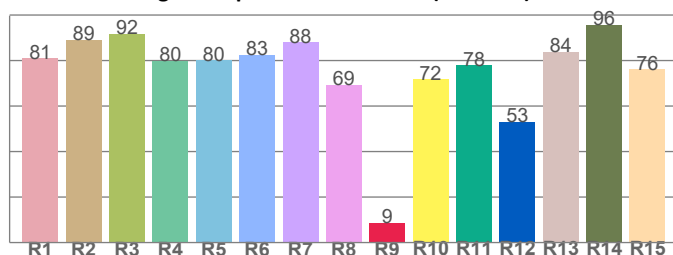


CRI R values, only R1-R8 are used to calculate final CRI value

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
81,0	89,1	91,9	79,8	80,2	82,6	87,9	69,3	8,7	71,8	78,0	53,1	83,9	95,8	76,1

Spectral power distribution (SPD) / W/nm – 0-100%

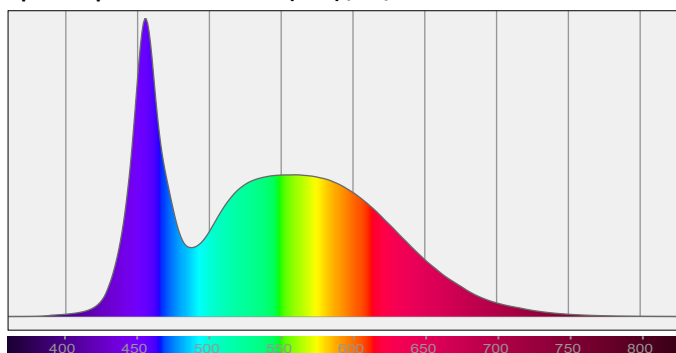


TM30-18 R_f-values per hue bin

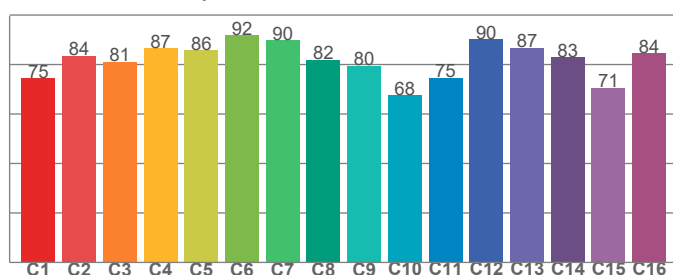

TM30 C values, 16 binned values out of total of 99 C values

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
74,5	83,6	81,1	86,7	85,7	91,8	89,7	81,9	79,5	67,5	74,7	90,2	86,8	83,1	70,5	84,5

Color Quality Scale by reference color

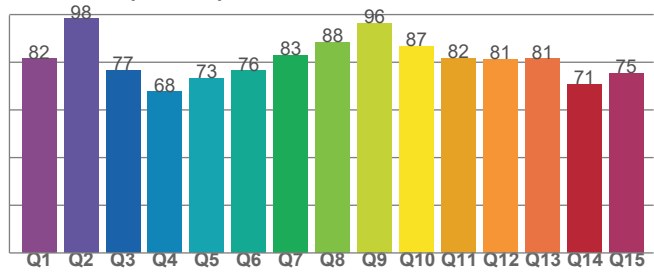

CQS Q values

Q1	Q2	Q3	Q4	Q5	Q6	Q7	Q8	Q9	Q10	Q11	Q12	Q13	Q14	Q15
81,6	98,2	76,8	67,6	73,3	76,5	83,1	88,5	96,3	86,8	81,6	81,2	81,5	70,7	75,4

Light Measurement Report

Print date: 7-11-2025


Measurement date and time: 7-11-2025 10:04:05 – Measurement no. VFR-251107-3985-MS

Measurement tracking No. and Link: [VT251107-004753](#)

Operator:



Beam Details

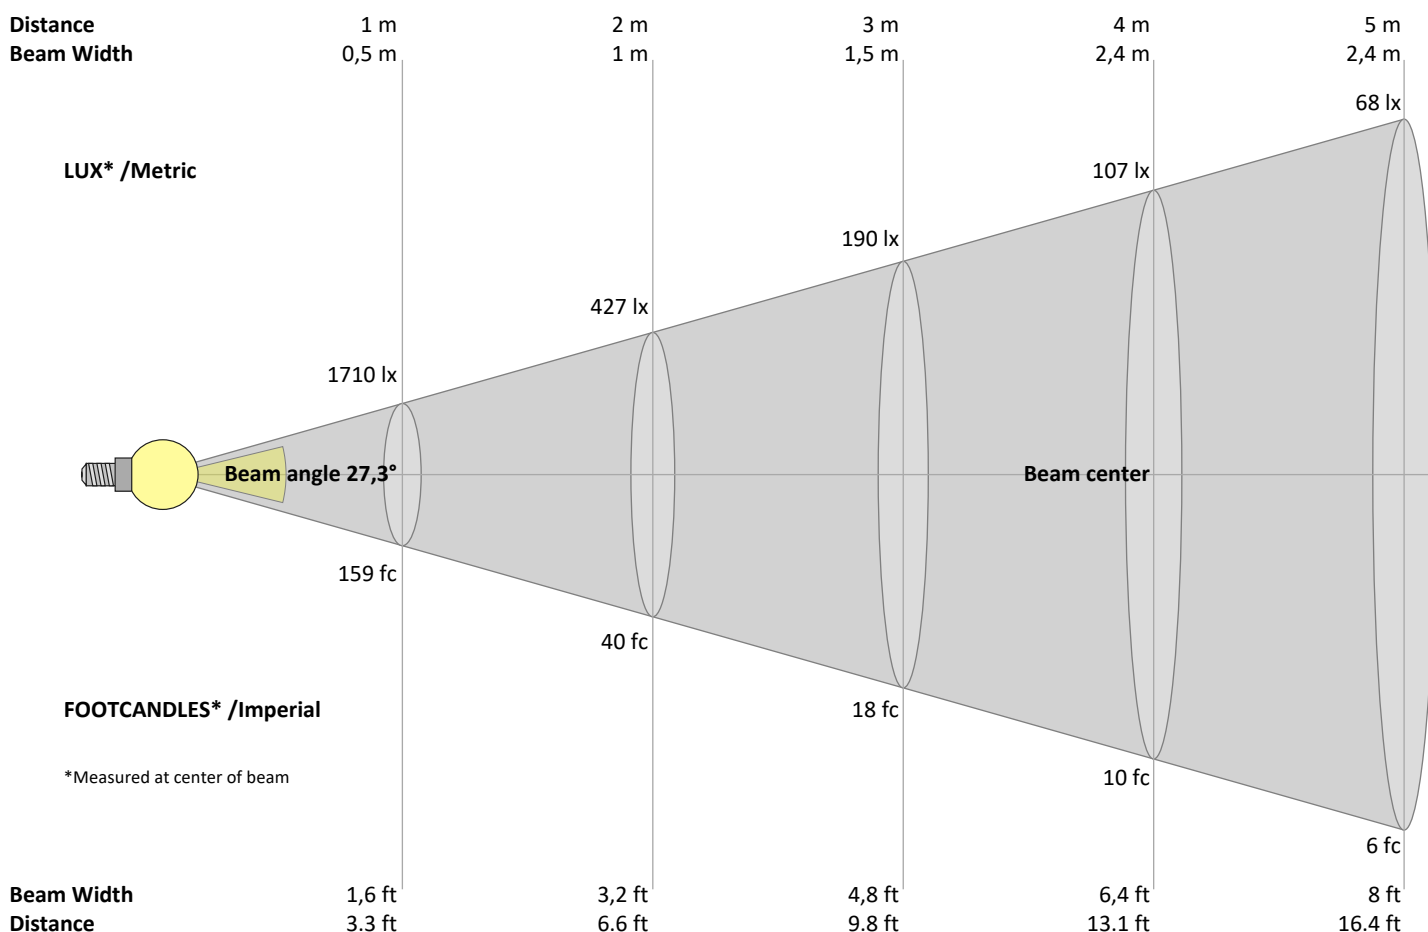

Beam intensities from 1 – 20 m

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	m
3,3	6,6	9,8	13,1	16,4	19,7	23	26,2	29,5	32,8	36,1	39,4	42,7	45,9	49,2	52,5	55,8	59,1	62,3	65,6	ft
1710	427	190	107	68	47	35	27	21	17	14	12	10	9	8	7	6	5	5	4	lux
158,8	39,7	17,6	9,9	6,4	4,4	3,2	2,5	2	1,6	1,3	1,1	0,9	0,8	0,7	0,6	0,5	0,5	0,4	0,4	fc

Intensities in 0° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
1710	1710	1619	1501	1365	1181	998	828	662	512	407	302	235	178	130	102	75	58	45	33	cd
100%	100%	95%	88%	80%	69%	58%	48%	39%	30%	24%	18%	14%	10%	8%	6%	4%	3%	3%	2%	of 0°val

Intensities in 90° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
1710	1710	1619	1501	1365	1181	998	828	662	512	407	302	235	178	130	102	75	58	45	33	cd
100%	100%	95%	88%	80%	69%	58%	48%	39%	30%	24%	18%	14%	10%	8%	6%	4%	3%	3%	2%	of 0°val

Intensities in 180° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
1710	1710	1619	1501	1365	1181	998	828	662	512	407	302	235	178	130	102	75	58	45	33	cd
100%	100%	95%	88%	80%	69%	58%	48%	39%	30%	24%	18%	14%	10%	8%	6%	4%	3%	3%	2%	of 0°val

Intensities in 270° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
1710	1710	1619	1501	1365	1181	998	828	662	512	407	302	235	178	130	102	75	58	45	33	cd
100%	100%	95%	88%	80%	69%	58%	48%	39%	30%	24%	18%	14%	10%	8%	6%	4%	3%	3%	2%	of 0°val

Light Measurement Report

Print date: 7-11-2025

Measurement date and time: 7-11-2025 10:04:05 – Measurement no. VFR-251107-3985-MS

Measurement tracking No. and Link: [VT251107-004753](#)

Operator:



Light Planning – UGR table

Uncorrected, comprehensive UGR table according to 117-1995

Reflectances											
	p Ceiling	70	70	50	50	30	70	70	50	50	30
	p Walls	50	30	50	30	30	50	30	50	30	30
	p Floor	20	20	20	20	20	20	20	20	20	20
Room size		Viewed Crosswise					Viewed Endwise				
H = mounting height above eye level		(Viewing direction orthogonal to lamp length axis)					(Viewing direction parallel to lamp length axis)				
X	Y										
2H	2H	14,5	15,0	14,6	15,3	15,4	14,5	15,0	14,6	15,3	15,4
	3H	15,1	15,8	15,5	16,0	16,2	15,1	15,8	15,5	16,0	16,2
	4H	15,4	16,0	15,8	16,2	16,5	15,4	16,0	15,8	16,2	16,5
	6H	15,6	16,1	15,8	16,4	16,7	15,6	16,1	15,8	16,4	16,7
	8H	15,6	16,1	15,9	16,4	16,8	15,6	16,1	15,9	16,4	16,8
	12H	15,5	16,0	15,9	16,4	16,8	15,5	16,0	15,9	16,4	16,8
4H	2H	14,7	15,3	15,1	15,5	15,8	14,7	15,3	15,1	15,5	15,8
	3H	15,6	16,1	16,0	16,5	16,9	15,6	16,1	16,0	16,5	16,9
	4H	15,9	16,4	16,3	16,8	17,3	15,9	16,4	16,3	16,8	17,3
	6H	16,1	16,6	16,6	16,9	17,3	16,1	16,6	16,6	16,9	17,3
	8H	16,1	16,6	16,6	16,9	17,3	16,1	16,6	16,6	16,9	17,3
	12H	16,1	16,4	16,6	16,8	17,3	16,1	16,4	16,6	16,8	17,3
8H	4H	16,0	16,4	16,5	16,8	17,1	16,0	16,4	16,5	16,8	17,1
	6H	16,2	16,5	16,7	17,0	17,5	16,2	16,5	16,7	17,0	17,5
	8H	16,3	16,6	16,8	17,1	17,7	16,3	16,6	16,8	17,1	17,7
	12H	16,3	16,5	16,9	17,0	17,6	16,3	16,5	16,9	17,0	17,6
12H	4H	15,9	16,3	16,4	16,7	17,2	15,9	16,3	16,4	16,7	17,2
	6H	16,3	16,5	16,8	17,0	17,6	16,3	16,5	16,8	17,0	17,6
	8H	16,3	16,5	16,9	17,0	17,6	16,3	16,5	16,9	17,0	17,6
Variations with the observer position for the luminaire spacings, S:											
S = 1.0H		1,9 / -0,9					1,9 / -0,9				
S = 1.5H		3,6 / -1,2					3,6 / -1,2				
S = 2.0H		5,1 / -1,7					5,1 / -1,7				

Coefficients of Utilization

Ceiling reflectance	80			70			50			30			10			0		
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR		(RCR: Room Cavity Ratio)			Room Values are expressed as percentage of Lumen delivered to the task surface													
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95
2	110	105	102	99	108	104	101	98	101	98	96	98	96	94	95	93	92	90
3	105	100	96	92	104	99	95	92	96	93	90	94	91	89	92	89	88	86
4	101	95	91	87	100	94	90	87	92	88	86	90	87	85	88	86	84	82
5	98	91	86	83	96	90	86	82	88	85	82	87	84	81	85	83	80	79
6	94	87	82	79	93	86	82	79	85	81	78	84	80	78	83	79	77	76
7	91	84	79	76	90	83	79	75	82	78	75	81	77	75	80	77	74	73
8	88	81	76	73	87	80	76	72	79	75	72	78	75	72	77	74	72	71
9	85	78	73	70	85	77	73	70	77	72	70	76	72	69	75	72	69	68
10	83	75	71	68	82	75	70	68	74	70	67	73	70	67	73	69	67	66

Light Measurement Report


Print date: 7-11-2025
Measurement date and time: 7-11-2025 10:04:05 – Measurement no. VFR-251107-3985-MS
Measurement tracking No. and Link: [VT251107-004753](#)
Operator:



Luminaire budgetary diagram

Uncorrected, comprehensive UGR table according to 117-1995

LAMPS (number of lamps)

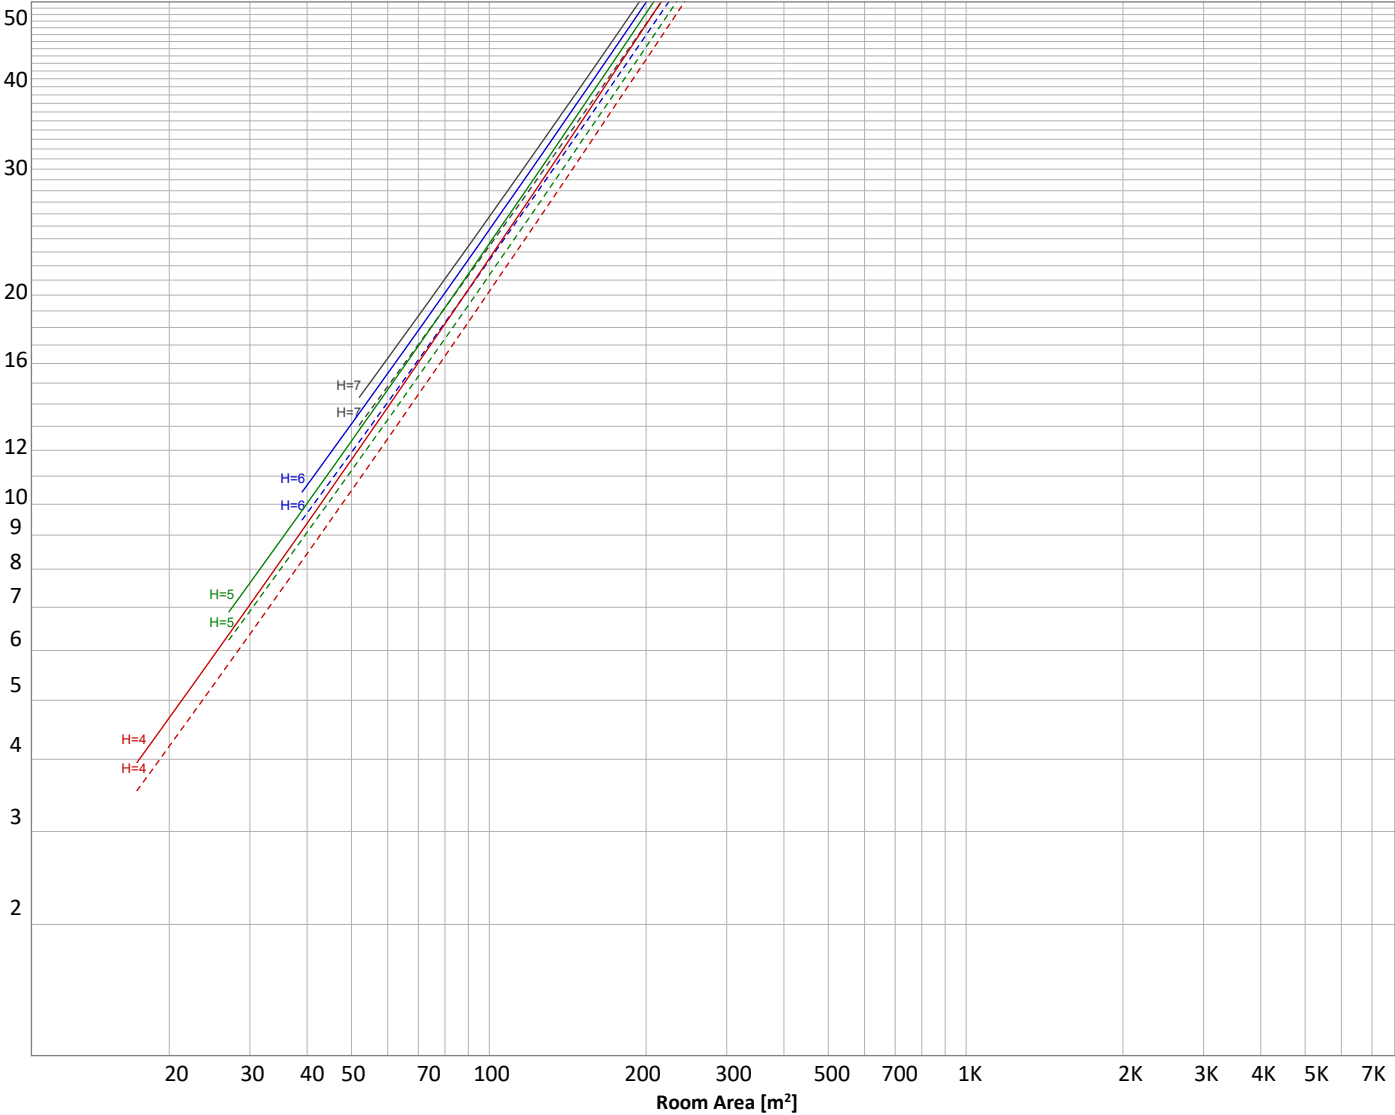

Conditions

H = Room height	Flux = 501 lm	p(%)		
H _{down} = Lamp distance from ceiling =	0.00 m	Line type	Ceiling reflectance	Wall reflectance
H _{work} = Work area height from floor =	0.00 m	-----	70	50
E _{work} = Average lux on work area =	100 lx	_____	50	30
				Floor reflectance
				20

Zonal Lumen Summary

0°-10°	10°-20°	20°-30°	30°-40°	40°-50°	50°-60°	60°-70°	70°-80°	80°-90°
142 lm	202 lm	92,6 lm	31,7 lm	12,9 lm	9,70 lm	7,11 lm	3,39 lm	0,570 lm
90°-100°	100°-110°	110°-120°	120°-130°	130°-140°	140°-150°	150°-160°	160°-170°	170°-180°
0,009 lm	0,006 lm	0,001 lm	0,000 lm	0,000 lm	0,008 lm	0,038 lm	0,053 lm	0,019 lm

Light Measurement Report

Print date: 7-11-2025

Measurement date and time: 7-11-2025 10:04:05 – Measurement no. VFR-251107-3985-MS

Measurement tracking No. and Link: [VT251107-004753](#)

Operator:



Outdoor Light Planning

Lumen per Zone

Zone (γ)	Lumen	% Total
0-10°	{LUM00-10} lm	#VALUE!
10-20°	{LUM10-20} lm	#VALUE!
20-30°	{LUM20-30} lm	#VALUE!
30-40°	{LUM30-40} lm	#VALUE!
40-50°	{LUM40-50} lm	#VALUE!
50-60°	{LUM50-60} lm	#VALUE!
60-70°	{LUM60-70} lm	#VALUE!
70-80°	{LUM70-80} lm	#VALUE!
80-90°	{LUM80-90} lm	#VALUE!
90-100°	{LUM90-100} lm	#VALUE!
100-110°	{LUM100-110} lm	#VALUE!
110-120°	{LUM110-120} lm	#VALUE!
120-130°	{LUM120-130} lm	#VALUE!
130-140°	{LUM130-140} lm	#VALUE!
140-150°	{LUM140-150} lm	#VALUE!
150-160°	{LUM150-160} lm	#VALUE!
160-170°	{LUM160-170} lm	#VALUE!
170-180°	{LUM170-180} lm	#VALUE!
Total	0 lm	#VALUE!

Intensity peaks

Max intensity	{PEAK} cd
Intensity, 90°	{INT90} cd
Intensity, 0°	{INT0} cd

Zonal Lumen summary

Zone (γ)	Lumen	% Total
0-30°	{LUM00-30} lm	#VALUE!
0-40°	{LUM00-40} lm	#VALUE!
0-60°	{LUM00-60} lm	#VALUE!
60-90°	{LUM60-90} lm	#VALUE!
70-100°	{LUM70-100} lm	#VALUE!
90-120°	{LUM90-120} lm	#VALUE!
0-90°	{LUM00-90} lm	#VALUE!
90-180°	{LUM90-180} lm	#VALUE!
0-180°	{LUM00-180} lm	#VALUE!

BUG rating

	Lumen	% Total
Forward light		
Low(0-30°)	{BUG0} lm	#VALUE!
Medium(30-60°)	{BUG1} lm	#VALUE!
High(60-80°)	{BUG2} lm	#VALUE!
Very high(80-90°)	{BUG3} lm	#VALUE!
Back light		
Low(0-30°)	{BUG4} lm	#VALUE!
Medium(30-60°)	{BUG5} lm	#VALUE!
High(60-80°)	{BUG6} lm	#VALUE!
Very high(80-90°)	{BUG7} lm	#VALUE!


Uplight

Low(90-100°)	{BUG8} lm	#VALUE!
High(100-180°)	{BUG9} lm	#VALUE!

IESNA TM-15-07

Luminaire Classification System For Outdoor Luminaires

BUG rating B1 U0 G0

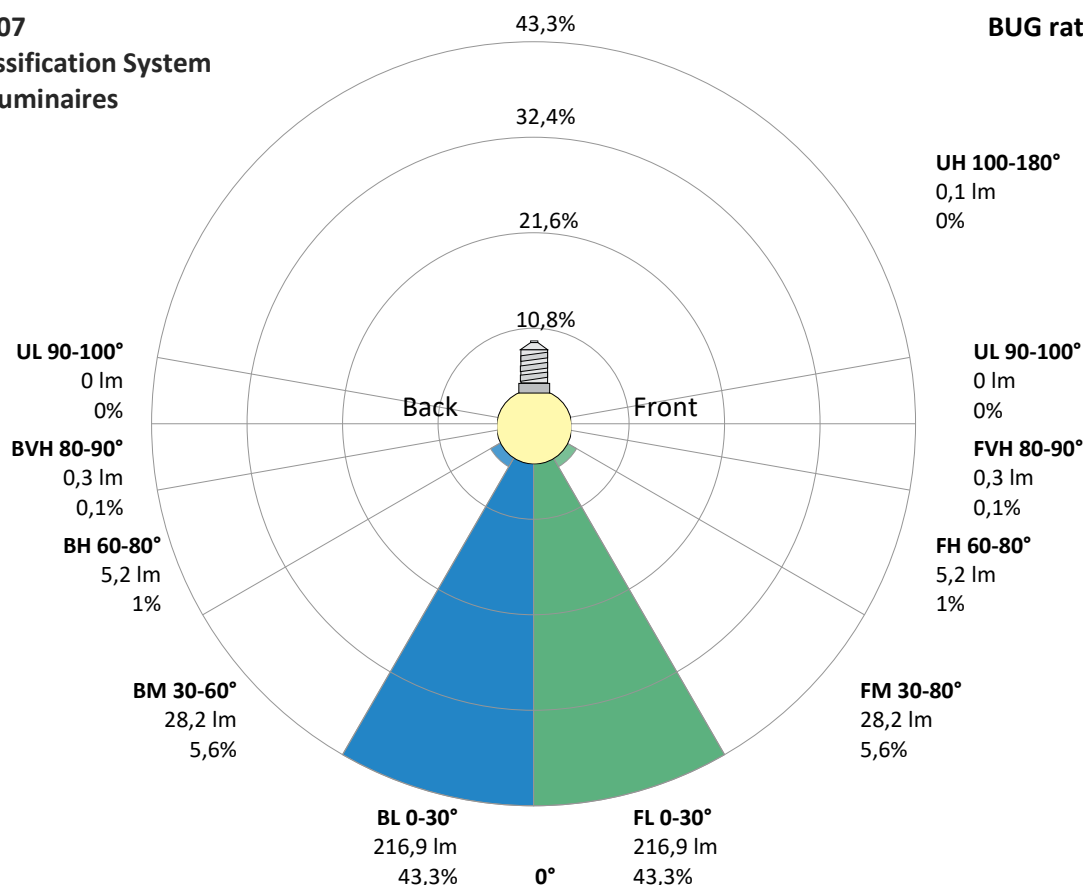

Light Measurement Report

Print date: 7-11-2025
Measurement date and time: 7-11-2025 10:04:05 – Measurement no. VFR-251107-3985-MS
Measurement tracking No. and Link: [VT251107-004753](#)
Operator:




Power Details


Input Power

Power feed to light source	5,4 W
Frequency of input power	50 Hz
RMS Input voltage feed, V_{RMS}	230 V
RMS Input current feed, I_{RMS}	0,053 A
Volt-Ampere or apparent power = $V_{RMS} \cdot I_{RMS}$	12,15 VA
Displacement factor of AC power feed	0,98
Power factor of AC current feed	0,44
Total harmonic distortion of the current	194,8%
Total harmonic distortion of the voltage	0,07%

Input Power Curve

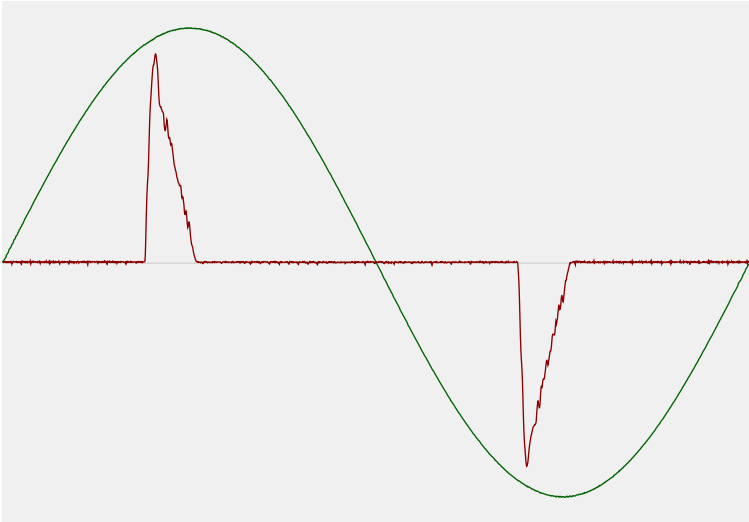

Efficiency

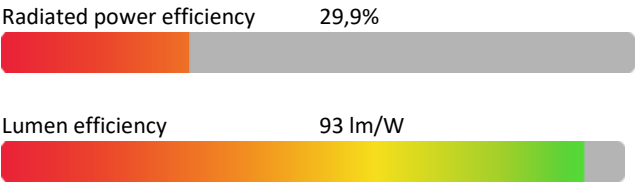

Stabilization Details

Warmup Conditions

Stable period	15 min
Stable change max	2,0%
Minimum time	15 min

Color Temperature Change

CCT start	6503 K
CCT shift	-3 K
CCT end	6500 K


Warmup Result

Total warmup time	Lamp stabilized in 15 min 2 sec
Warmup variation	+0,2%

Output Change

Output start	501 lm
Output change	+1 lm
Output end	501 lm

Stabilization Curve

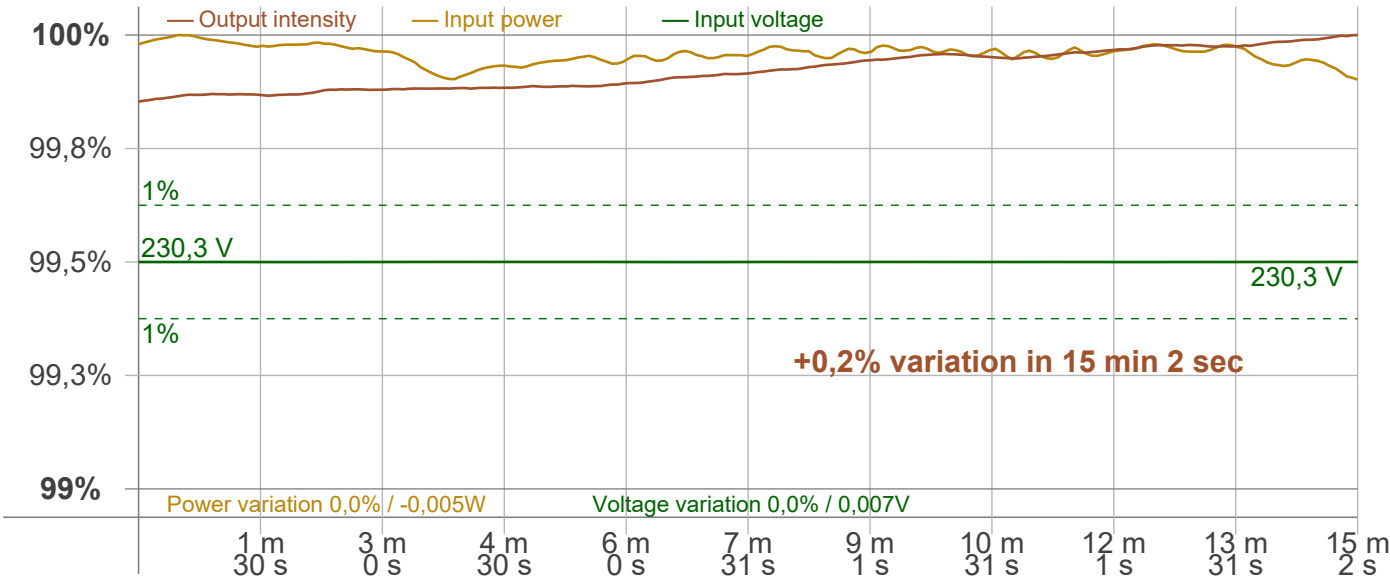

Light Measurement Report


Print date: 7-11-2025
Measurement date and time: 7-11-2025 10:04:05 – Measurement no. VFR-251107-3985-MS
Measurement tracking No. and Link: [VT251107-004753](#)
Operator:




Flicker /TLA details

Flicker Meter Type	Viso Systems LabFlicker	Measurement time	
Frequency of input power	50 Hz	PstLM	180 sec
Flicker/TLA sample rate	n/a samples/s	All other indices	1,2 sec
Flicker indices according to Illuminating Engineering Society (IES)		Flicker indices according to California Energy Commission (CEC) 2016b	
Flicker frequency	n/a Hz	JA8/10 40 Hz	n/a %
Percent Flicker	n/a %	JA8/10 90 Hz	n/a %
Flicker index	n/a	JA8/10 200 Hz	n/a %
		JA8/10 400 Hz	n/a %
		JA8/10 1000 Hz	n/a %
TLA indices (re IEC TR 61547-1, IEC 61000-3-3 and IEC 61000-4-15)		Flicker indices according to Lighting Research Center (2015)	
PstLM value (F < 80 Hz)	n/a	Perception metric, Assist Mp	n/a
SVM value (80 < F < 2000 Hz)	n/a		

Flicker frame (frame of one flicker period in time domain)

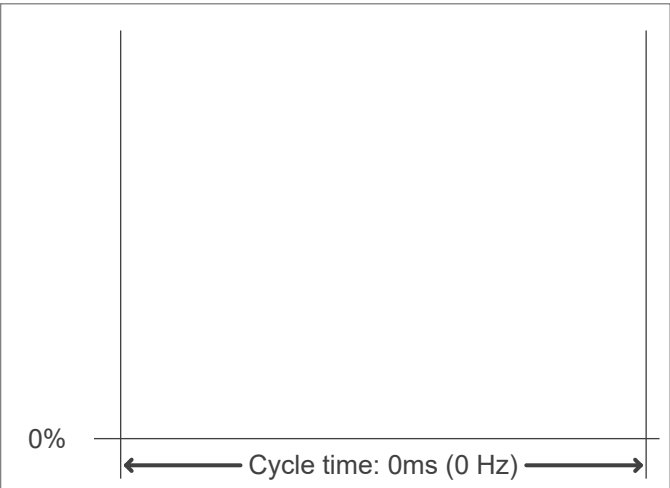

Flicker FFT (flicker curve in frequency domain)

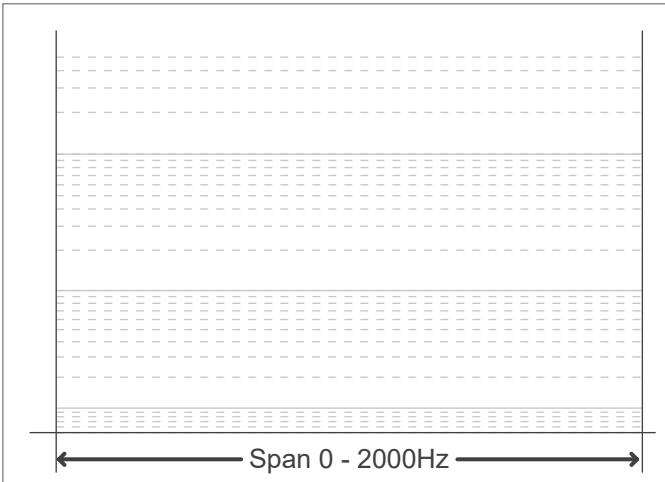

IEEE 1789 Frequency/modulation plot

